

YKK AP AMERICA INC.

SERIES YHS 50 TU STOREFRONT

OUTSIDE GLAZED - HVHZ IMPACT RATED

INSTALLATION NOTES:

1. SEE SHEET 10 FOR ANCHOR TYPE REQUIREMENTS, MINIMUM EMBEDMENTS, AND MINIMUM EDGE DISTANCES. ALL ANCHOR REQUIREMENTS MUST BE ADHERED TO. ANY DEVIATIONS FROM ANCHOR REQUIREMENTS REQUIRES SEPARATE EVALUATION AND APPROVAL.

2. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.

3. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.

4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.

5. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.

6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.

7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.

9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

10.INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

C. MASONRY - CMU UNIT STRENGTH CONFORMS TO ASTM C-90, WITH MIN. COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MIN. GROUT COMPRESSIVE STRENGTH OF 2000 PSI.

D. STEEL - MINIMUM YIELD STRENGTH OF 36 KSI. MINIMUM 12 GA. WALL THICKNESS.

E. STEEL - MINIMUM YIELD STRENGTH OF 36 KSI. MINIMUM 18 GA. WALL THICKNESS WITH 2X WOOD BACKING.

F. ALUMINUM - MINIMUM 1/8 INCH THICK 6063-T5 ALUMINUM.

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

TAS 201-94

TAS 202-94

TAS 203-94

AAMA 501-05

ASTM E283-99

ASTM E330-02

ASTM E331-00

ASTM E1886-05

ASTM E1996-09

2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.

3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.

4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE. SEE SHEETS 3 & 4 FOR LMI AND SMI GLASS TYPES.

6. STOREFRONT FRAME MATERIAL: ALUMINUM 6063-T5

7. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.

8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEETS 3 & 4 FOR GLAZING DETAILS.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	C	INSTALLATION & GENERAL NOTES
2	B	ELEVATION & ANCHOR LAYOUT
3	C	DRY GLAZING DETAILS
4	C	WET GLAZING DETAILS
5	B	MULLION TABLES
6	B	TYPE A & B ANCHOR TABLES
7	B	TYPE C & D ANCHOR TABLES
8	B	DOOR MULLION TABLE
9	B	DOOR MULLION TABLES (1)
10	B	VERTICAL SECTIONS & ANCHOR DESCRIPTIONS
11	B	HORIZONTAL SECTIONS
12	B	COMPONENTS & BILL OF MATERIALS
13	B	COMPONENTS & BILL OF MATERIALS

INSTRUCTIONS FOR USE:

1. DETERMINE DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BLDG, HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.

2. SEE CHARTS ON SHEETS 3 & 4 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE.

3. CHECK MULLION CAPACITY FOR A GIVEN SPACING AND HEIGHT USING CHARTS ON SHEET 5 FOR STORE FRONT MULLION AND SHEETS 8 & 9 FOR DOOR MULLION, THE CAPACITY SHOULD EXCEED THE DESIGN LOAD.

4. USING CHART ON SHEET 6 & 7 SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE.

5. THE LOWEST VALUE RESULTING FROM STEP 2, 3 AND 4 SHALL APPLY TO ENTIRE SYSTEM.



YKK AP AMERICA
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE:

YHS 50 TU

ALUMINUM STOREFRONT SYSTEM

INSTALLATION & GENERAL NOTES


PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17
C-FBC CODE UPDATE	RV	07.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

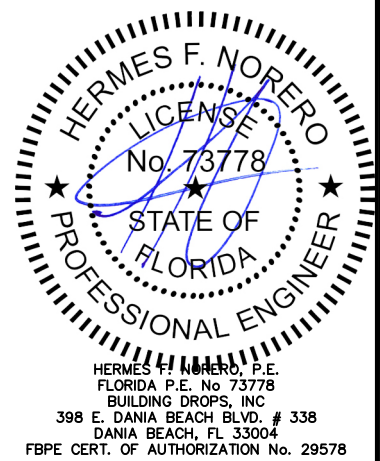

FL #:

FL14218

DATE:

10.20.15

DWG. BY:

SM

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

YKK161


SHEET:

1

OF 13


10/13/2017 12:10 AM

s:\projects\ykk ap america, inc\cc-17-0710 fbc submittal - fbc 2017 (6th edition) code change\week 2 - (aug 4th) documents\dwgs\14218.10\ykk161.yhs 50 tu og hvhs.dwg

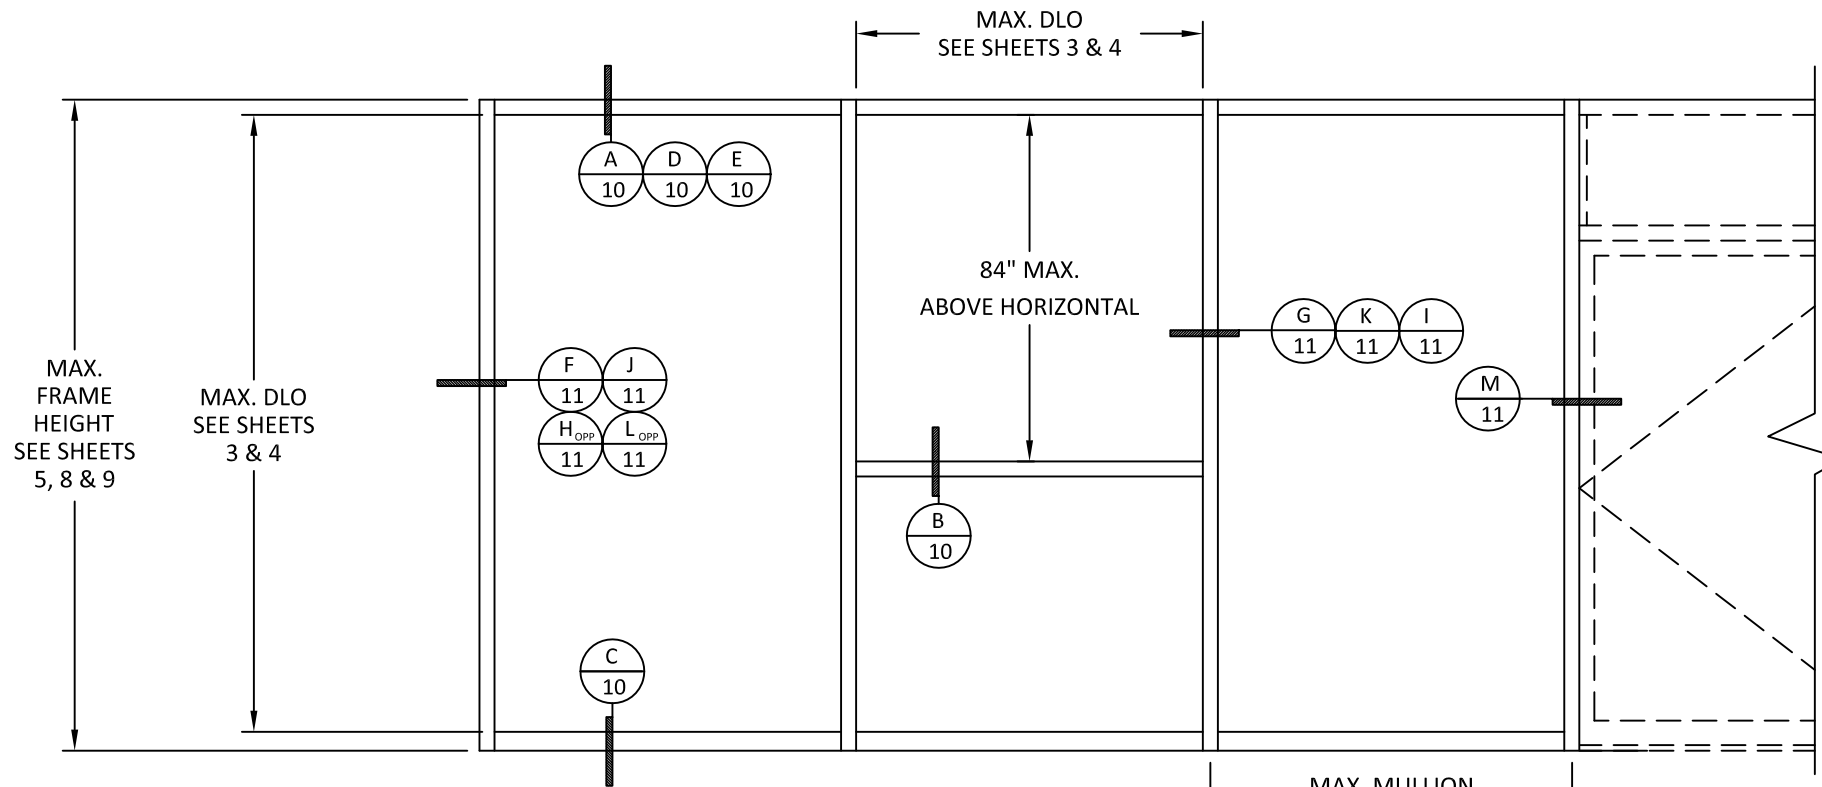


ELEVATION
TYPICAL YHS 50 TU STOREFRONT


SEE SEPARATE DOOR APPROVAL FOR DOOR
RATING & DETAILS.
LOWER DESIGN PRESSURE FROM
STOREFRONT OR DOOR APPROVAL WILL
APPLY TO ENTIRE SYSTEM.

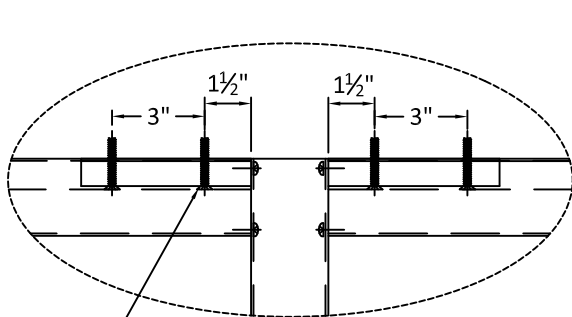

ANCHORS, TYPE A, B, C OR D
SEE SHEETS 6 & 7 FOR QUANTITIES AND SHEET
10 FOR DESCRIPTION

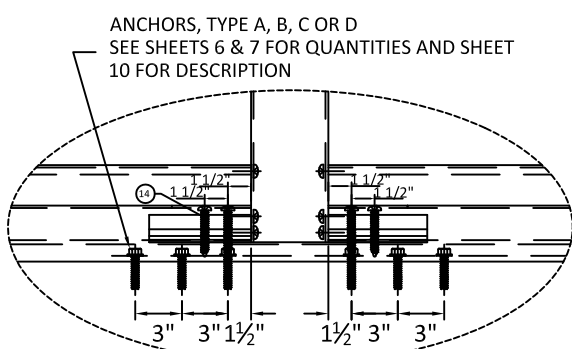

ANCHORS, TYPE A, B, C OR D
SEE SHEETS 6 & 7 FOR QUANTITIES AND SHEET
10 FOR DESCRIPTION

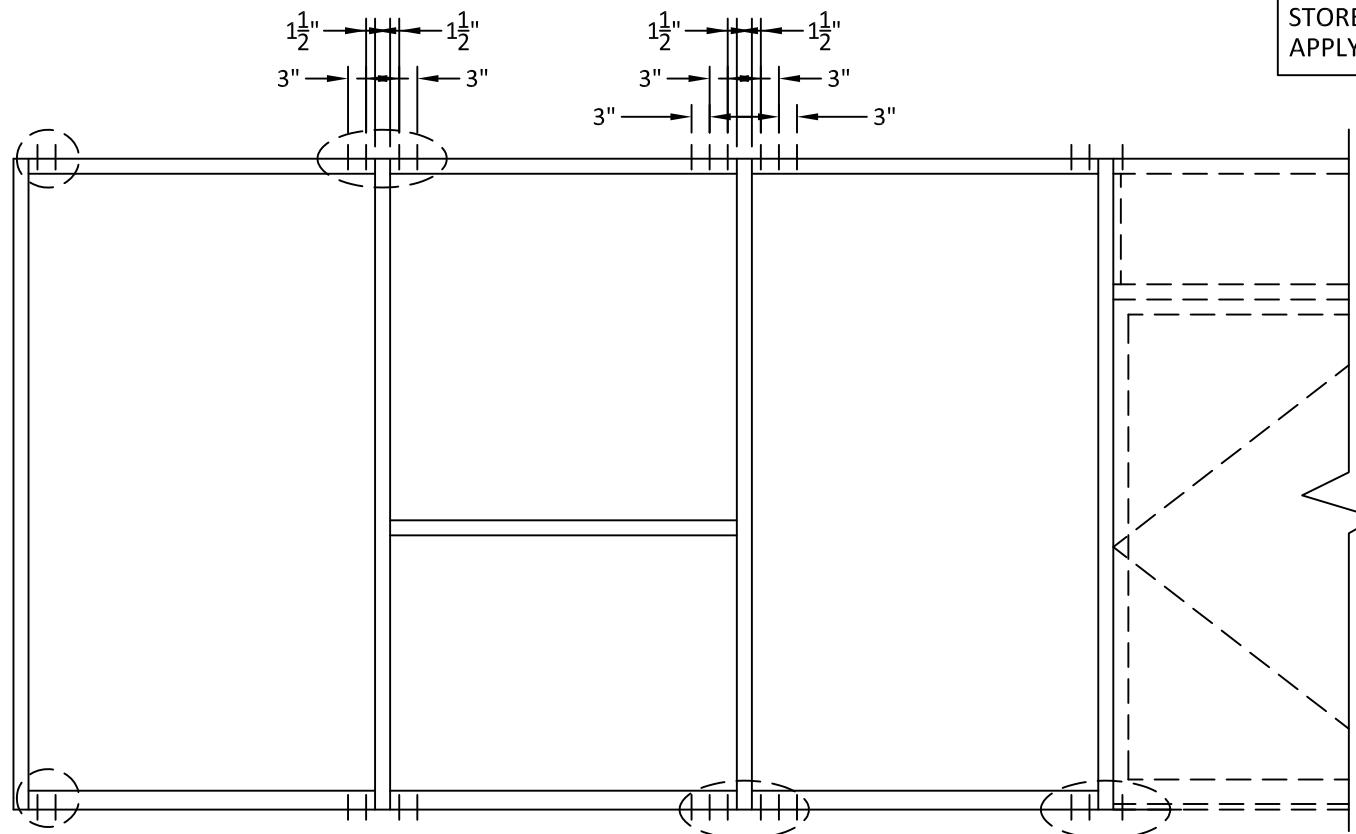

TYPICAL ANCHOR LAYOUT

FOR DOOR ADJACENT
MULLION ANCHOR
REQUIREMENTS SEE
SHEETS 8 & 9



YKK AP AMERICA
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

ELEVATION &
ANCHOR LAYOUT

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL14218
DATE:	10.20.15
DWG. BY:	SM
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	2

GLASS LOAD CAPACITY (PSF)		
NOMINAL DIMS. (in)		INSUL. LAM. GLASS
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)
27.5	54.375	70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5	60.375	70.0
69.5		68.4
27.5		70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5	66.375	70.0
57.5		70.0
63.5		70.0
69.5		70.0
27.5		70.0
33.5		70.0
39.5	72.375	70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5		63.4
69.5		63.5
27.5	78.375	70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5	84.375	63.4
69.5		57.9
27.5		70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5	90.375	70.0
57.5		70.0
63.5		63.4
69.5		70.0
27.5		70.0
33.5		70.0
39.5	96.375	70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5		70.0
69.5		70.0
27.5	102.375	70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5	108.375	70.0
69.5		70.0
27.5		70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5	114.375	70.0
57.5		70.0
63.5		70.0
69.5		70.0
27.5		70.0
33.5		70.0

GLASS LOAD CAPACITY (PSF)		
NOMINAL DIMS. (in)		INSUL. LAM. GLASS
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)
27.5	54.375	70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5	60.375	70.0
69.5		68.4
27.5		70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5	66.375	70.0
57.5		70.0
63.5		70.0
69.5		70.0
27.5		70.0
33.5		70.0
39.5	72.375	70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5		63.4
69.5		63.5
27.5	78.375	70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5	84.375	63.4
69.5		57.9
27.5		70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5	90.375	70.0
57.5		70.0
63.5		63.4
69.5		70.0
27.5		70.0
33.5		70.0
39.5	96.375	70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5		70.0
69.5		70.0
27.5	102.375	70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5		70.0
57.5		70.0
63.5	108.375	70.0
69.5		70.0
27.5		70.0
33.5		70.0
39.5		70.0
45.5		70.0
51.5	114.375	70.0
57.5		70.0
63.5		70.0
69.5		70.0
27.5		70.0
33.5		70.0

DAYLITE OPENING DIMENSIONS:
DAYLITE OPENING WIDTH:
• NOMINAL PANEL WIDTH - 2.500"
DAYLITE OPENING HEIGHT:
• FRAME HEIGHT - 5.625"

1-5/16" O.A. LAMINATED INSULATED GLASS CONSISTING OF:
1/4" TEMPERED GLASS,
1/2" AIR SPACE,
1/4" HEAT STRENGTHENED GLASS,
0.060" EASTMAN CHEM. CO. SAFLEX PVB,
1/4" HEAT STRENGTHENED GLASS

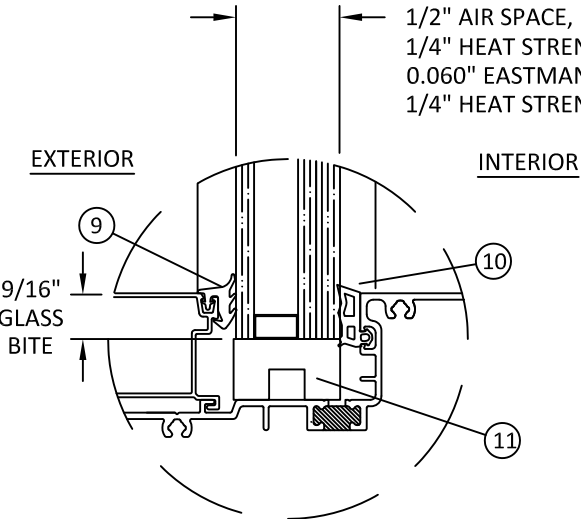


GLAZING DETAIL B
(DRY GLAZED)

DRY GLAZED GLASS TYPES

LARGE & SMALL MISSILE IMPACT

1-5/16" O.A. LAMINATED INSULATED GLASS CONSISTING OF:
1/4" HEAT STRENGTHENED OR TEMPERED GLASS,
1/2" AIR SPACE,
1/4" HEAT STRENGTHENED GLASS,
0.090" SENTRYGLAS BY KURARAY,
FORMERLY KNOWN AS SGP BY DUPONT,
1/4" HEAT STRENGTHENED GLASS

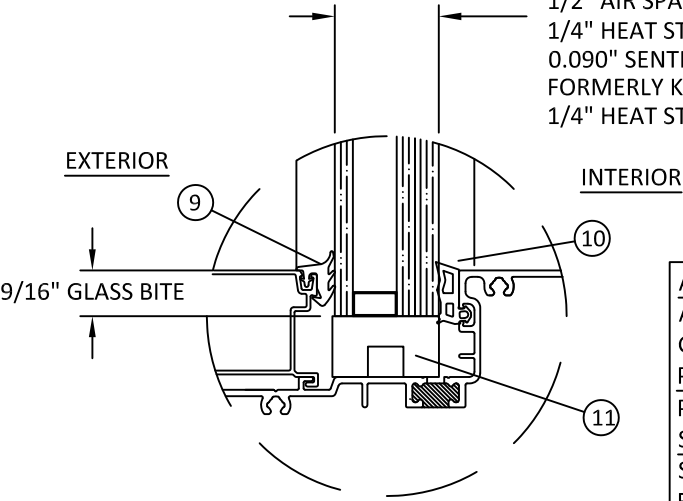


GLAZING DETAIL A
(DRY GLAZED)

ALUMINUM BOX SPACER:
AROUND THE PERIMETER OF THE GLASS.
PRIMARY SEALANT:
POLYISOBUTYLENE (PIB).
SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR FABRICATION OF INSULATED GLASS UNITS.

DRY GLAZED GLASS TYPES


SMALL MISSILE IMPACT ONLY

1-5/16" O.A. LAMINATED INSULATED GLASS CONSISTING OF:
1/4" TEMPERED GLASS,
1/2" AIR SPACE,
1/4" HEAT STRENGTHENED GLASS,
0.060" TROSIFOL BY KURARAY,
FORMERLY KNOWN AS BUTACITE BY DUPONT,
1/4" HEAT STRENGTHENED GLASS

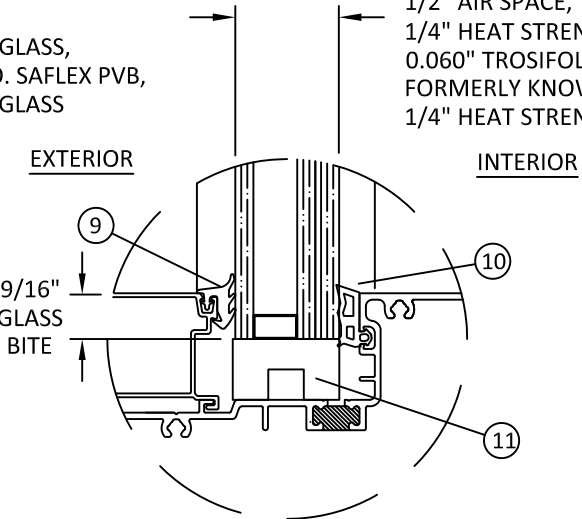


GLAZING DETAIL C
(DRY GLAZED)

1-5/16" O.A. LAMINATED INSULATED GLASS CONSISTING OF:
1/4" TEMPERED GLASS,
1/2" AIR SPACE,
1/4" HEAT STRENGTHENED GLASS,
0.035" SENTRYGLAS BY KURARAY,
FORMERLY KNOWN AS SGP BY DUPONT,
1/4" HEAT STRENGTHENED GLASS

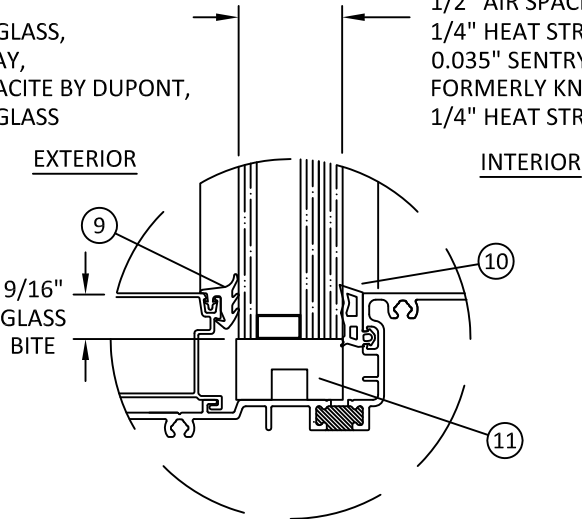

GLAZING DETAIL D
(DRY GLAZED)

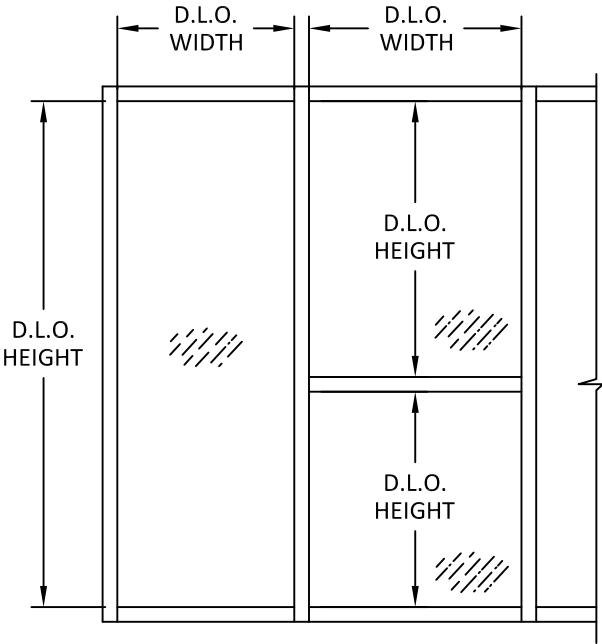

- * NOTE:
- GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-04 (3 SEC. GUSTS) AND CHAPTER 17 OF THE CURRENT FBC FOR SIZES OTHER THAN TESTED.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER CHAPTER 24.
 - D.L.O. MAY NOT EXCEED MAX DIMENSIONS IN GLASS CHARTS FOR GLASS TYPE.



YKK AP AMERICA

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

DRY GLAZING DETAILS


PREPARED BY:
BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17
C-FBC CODE UPDATE	RV	07.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

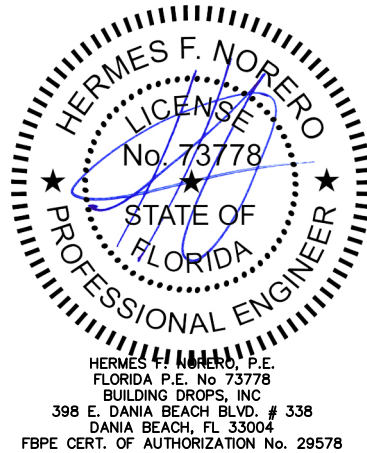

FL #:	FL14218
DATE:	10.20.15
DWG. BY:	SM
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	

3


WET GLAZED GLASS TYPES
LARGE & SMALL MISSILE IMPACT

GLASS LOAD CAPACITY (PSF)			
NOMINAL DIMS. (in)		GLASS TYPE 'E'	GLASS TYPE 'F' & 'G'
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
27.5	54.375	70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	44.2
57.5		70.0	44.2
63.5	60.375	70.0	48.7
69.5		68.4	41.8
27.5		70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5	66.375	70.0	50.0
57.5		70.0	44.2
63.5		70.0	39.6
69.5		70.0	39.6
27.5		70.0	43.4
33.5	72.375	70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	50.0
57.5		70.0	44.2
63.5		70.0	39.6
69.5	78.375	63.4	35.8
27.5		57.9	-
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5	84.375	70.0	50.0
57.5		70.0	44.2
63.5		70.0	-
69.5		57.9	-
27.5		70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	44.2
57.5		70.0	-
63.5		63.4	-
69.5		57.9	-




GLASS LOAD CAPACITY (PSF)			
NOMINAL DIMS. (in)		GLASS TYPE 'E'	GLASS TYPE 'F' & 'G'
DLO WIDTH	DLO HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
27.5	90.375	70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	44.2
57.5		70.0	-
63.5	96.375	63.4	-
27.5		70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	-
57.5	102.375	70.0	-
27.5		70.0	50.0
33.5		70.0	50.0
39.5		70.0	50.0
45.5		70.0	50.0
51.5		70.0	-
57.5	108.375	70.0	-
27.5		50.0	50.0
33.5		50.0	50.0
39.5		50.0	50.0
45.5		50.0	-
51.5		50.0	-
57.5	114.375	50.0	50.0
27.5		50.0	50.0
33.5		50.0	50.0
39.5		50.0	50.0
45.5		50.0	50.0
51.5		50.0	-

DAYLITE OPENING DIMENSIONS:
DAYLITE OPENING WIDTH:
• NOMINAL PANEL WIDTH - 2.500"
DAYLITE OPENING HEIGHT:
• FRAME HEIGHT - 5.625"

- * NOTE:
- GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-04 (3 SEC. GUSTS) AND CHAPTER 17 OF THE CURRENT FBC FOR SIZES OTHER THAN TESTED.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER CHAPTER 24.
 - D.L.O. MAY NOT EXCEED MAX DIMENSIONS IN GLASS CHARTS FOR GLASS TYPE.

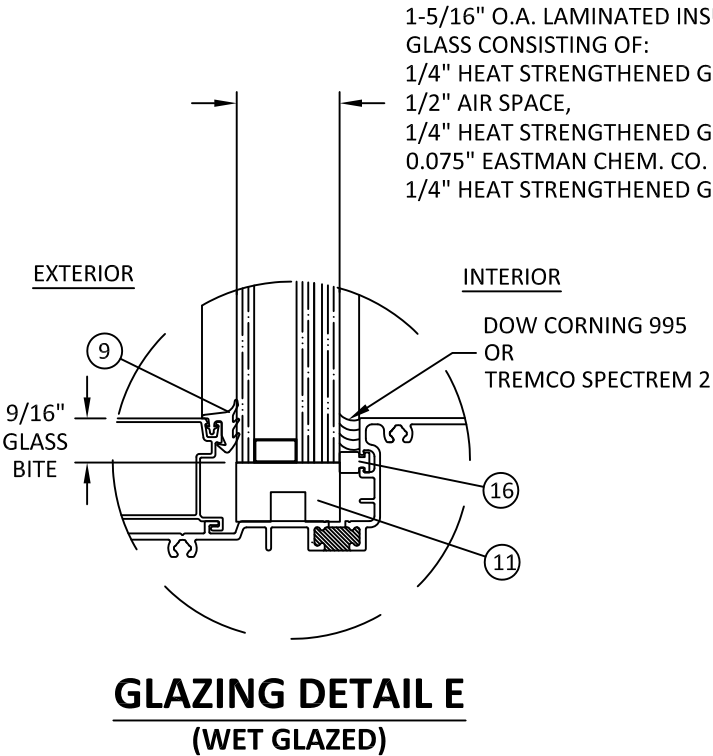

ALUMINUM BOX SPACER:
AROUND THE PERIMETER OF THE GLASS.
PRIMARY SEALANT:
POLYISOBUTYLENE (PIB).
SECONDARY SEALANT:
STRUCTURAL SILICONE INTENDED FOR FABRICATION OF INSULATED GLASS UNITS.

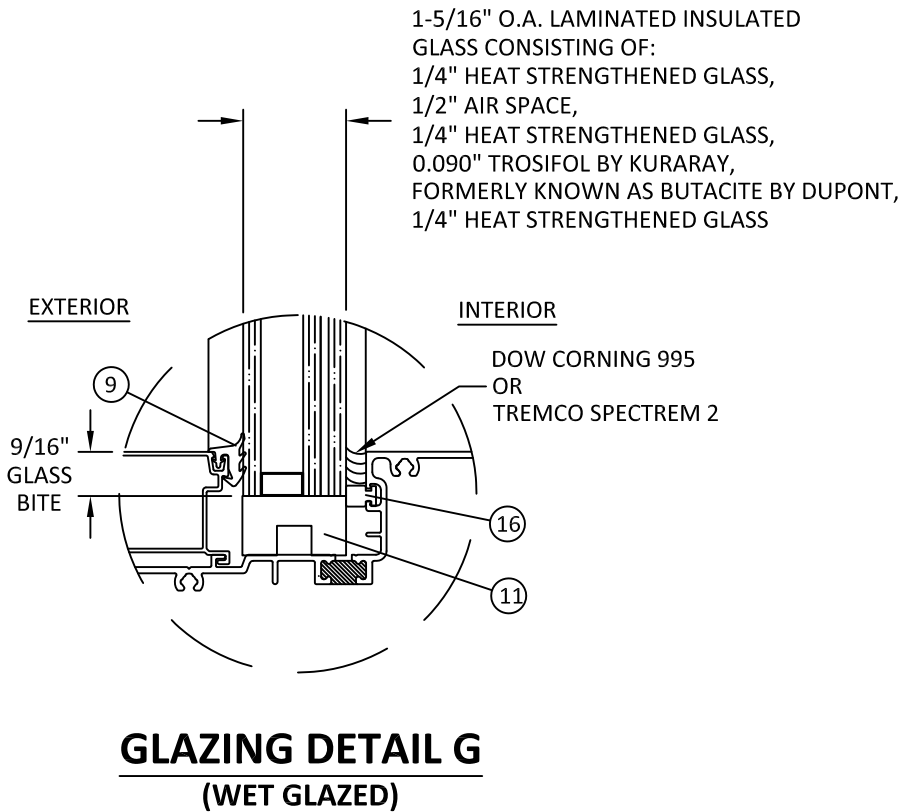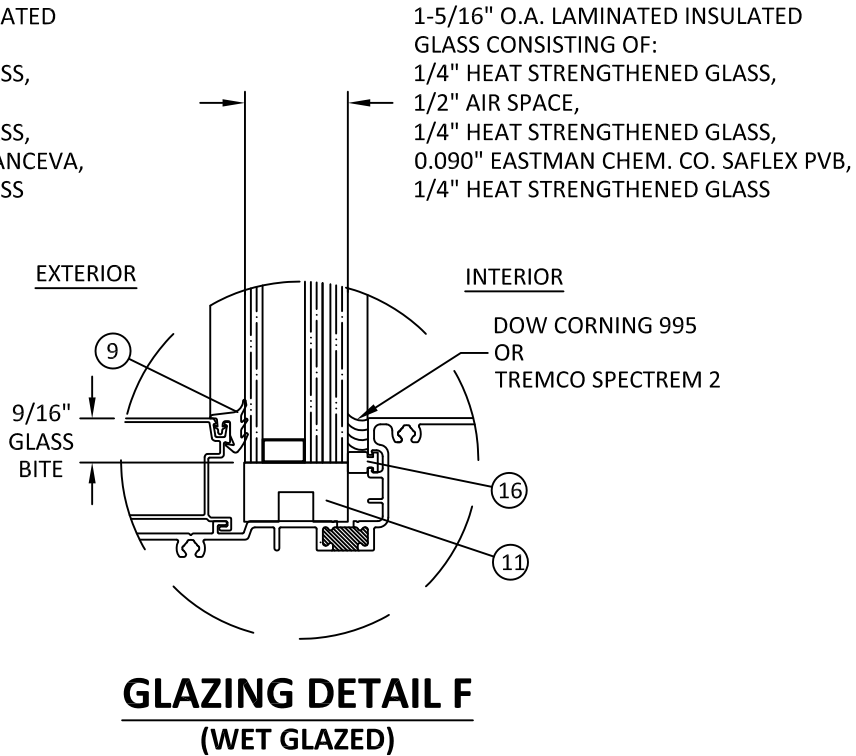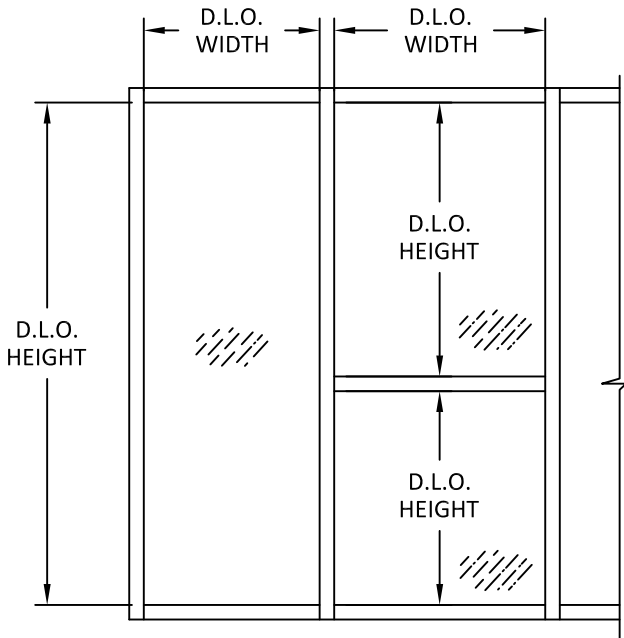

YKK AP AMERICA

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

WET GLAZING DETAILS


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17
C-FBC CODE UPDATE	RV	07.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

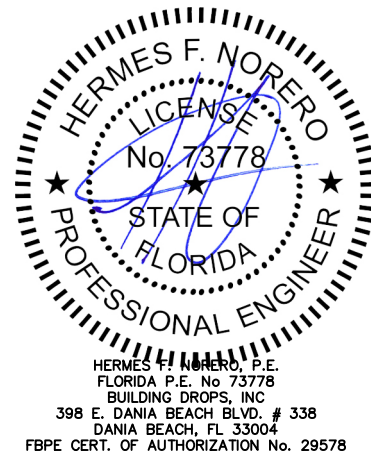

FL #:

FL14218

DATE: 10.20.15

DWG. BY: SM

CHK. BY: HFN

SCALE: NTS

DWG. #: YKK161


SHEET:

4

MULLION LOAD TABLES


JAMB/MULLION LOAD CAPACITY - PSF WITH OR WITHOUT INTERMEDIATE HORIZONTALS				
NOMINAL DIMS.		STANDARD CONFIG.	HEAVY CONFIG.	EXP. MULLION
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	60	70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54		70.0	70.0	70.0
60		70.0	70.0	70.0
66		70.0	70.0	70.0
72	66	70.0	70.0	70.0
30		70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54		70.0	70.0	70.0
60		70.0	70.0	70.0
66	72	70.0	70.0	70.0
72		50.0	70.0	70.0
30		70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54		70.0	70.0	70.0
60	78	70.0	70.0	70.0
66		50.0	70.0	70.0
72		50.0	70.0	70.0
30		70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54	84	70.0	70.0	70.0
60		50.0	70.0	70.0
66		--	70.0	70.0
72		--	70.0	--
30		70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48	90	70.0	70.0	70.0
54		50.0	70.0	70.0
60		--	70.0	70.0
66		--	70.0	--
72		--	70.0	--

JAMB/MULLION LOAD CAPACITY - PSF WITH OR WITHOUT INTERMEDIATE HORIZONTALS				
NOMINAL DIMS.		STANDARD CONFIG.	HEAVY CONFIG.	EXP. MULLION
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	96	70.0	70.0	70.0
36		70.0	70.0	70.0
42		70.0	70.0	70.0
48		70.0	70.0	70.0
54		50.0	70.0	70.0
60		--	70.0	70.0
66		--	70.0	--
30	102	70.0	70.0	70.0
36		70.0	70.0	70.0
42		66.7	70.0	70.0
48		50.0	70.0	70.0
54		--	70.0	70.0
60		--	70.0	--
30	108	70.0	70.0	70.0
36		65.6	70.0	70.0
42		56.2	70.0	70.0
48		50.0	70.0	70.0
54		--	70.0	70.0
60		--	70.0	--
30	114	--	50.0	50.0
36		--	50.0	50.0
42		--	50.0	50.0
48		--	50.0	50.0
54		--	50.0	50.0
30	120	--	50.0	50.0
36		--	50.0	50.0
42		--	50.0	50.0
48		--	50.0	50.0
54		--	50.0	50.0

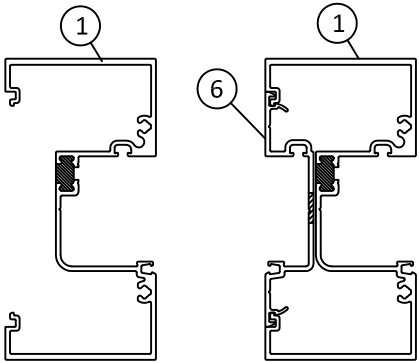


JAMB MULLION

STD. CONFIGURATION

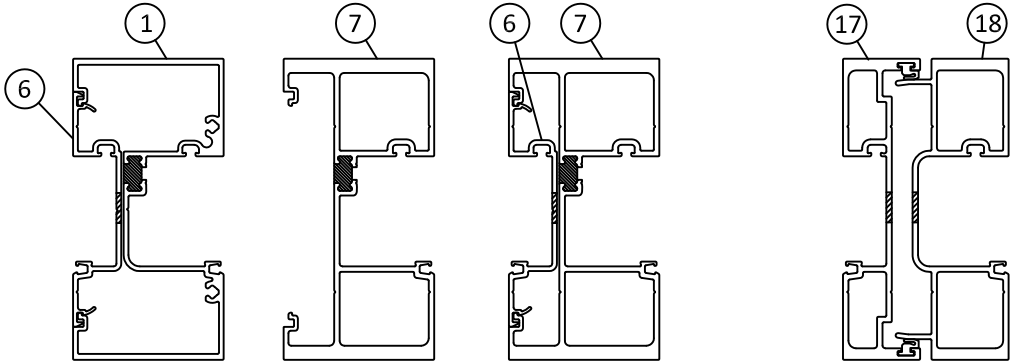

JAMB JAMB MULLION

EXPANSION
MULLION

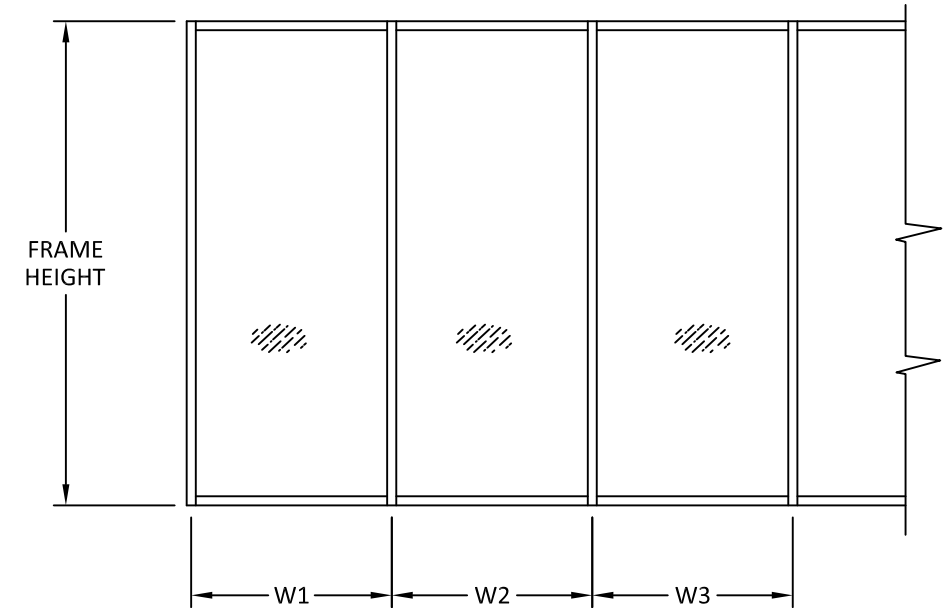

WIDTH (W) = W1 (JAMB)

WIDTH (W) = $\frac{W2 + W3}{2}$ (MULLION)



YKK AP AMERICA

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

MULLION TABLES

PREPARED BY:


BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

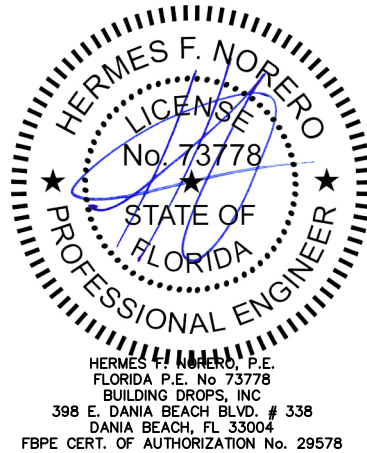

FL #:	FL14218
DATE:	10.20.15
DWG. BY:	CHK. BY:
SM	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	

5

ANCHOR TYPE 'A & B' TABLES

ANCHOR LOAD CAPACITY - PSF					
EXT. (+) & INT. (-)					
NOMINAL DIMS.		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
WIDTH (W)	FRAME HEIGHT	A2	A3	B2	B3
30.0	60.0	70.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0	70.0
42.0		70.0	70.0	70.0	70.0
48.0		70.0	70.0	70.0	70.0
54.0		70.0	70.0	70.0	70.0
60.0		70.0	70.0	70.0	70.0
66.0		70.0	70.0	70.0	70.0
72.0	66.0	70.0	70.0	70.0	70.0
30.0		70.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0	70.0
42.0		70.0	70.0	70.0	70.0
48.0		70.0	70.0	70.0	70.0
54.0		70.0	70.0	70.0	70.0
60.0		70.0	70.0	70.0	70.0
66.0	72.0	70.0	70.0	70.0	70.0
72.0		65.7	70.0	70.0	70.0
30.0		70.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0	70.0
42.0		70.0	70.0	70.0	70.0
48.0		70.0	70.0	70.0	70.0
54.0		70.0	70.0	70.0	70.0
60.0	78.0	70.0	70.0	70.0	70.0
66.0		65.7	70.0	70.0	70.0
72.0		60.2	70.0	70.0	70.0
30.0		70.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0	70.0
42.0		70.0	70.0	70.0	70.0
48.0		70.0	70.0	70.0	70.0
54.0	84.0	70.0	70.0	70.0	70.0
60.0		66.7	70.0	70.0	70.0
66.0		60.6	70.0	70.0	70.0
72.0		55.6	70.0	70.0	70.0
30.0		70.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0	70.0
42.0		70.0	70.0	70.0	70.0
48.0		70.0	70.0	70.0	70.0
54.0		68.8	70.0	70.0	70.0
60.0		61.9	70.0	70.0	70.0
66.0		56.3	70.0	70.0	70.0
72.0		51.6	70.0	70.0	70.0



ANCHOR LOAD CAPACITY - PSF					
EXT. (+) & INT. (-)					
NOMINAL DIMS.		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
WIDTH (W)	FRAME HEIGHT	A2	A3	B2	B3
30.0	90.0	70.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0	70.0
42.0		70.0	70.0	70.0	70.0
48.0		70.0	70.0	70.0	70.0
54.0		64.2	70.0	70.0	70.0
60.0		57.8	70.0	70.0	70.0
66.0		52.6	70.0	70.0	70.0
72.0	96.0	48.2	70.0	68.1	70.0
30.0		70.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0	70.0
42.0		70.0	70.0	70.0	70.0
48.0		67.8	70.0	70.0	70.0
54.0		60.2	70.0	70.0	70.0
60.0		54.2	70.0	70.0	70.0
66.0	102.0	49.3	70.0	69.7	70.0
30.0		70.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0	70.0
42.0		70.0	70.0	70.0	70.0
48.0		63.8	70.0	70.0	70.0
54.0		56.7	70.0	70.0	70.0
60.0		51.0	70.0	70.0	70.0
66.0	108.0	70.0	70.0	70.0	70.0
72.0		70.0	70.0	70.0	70.0
30.0		70.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0	70.0
42.0		68.8	70.0	70.0	70.0
48.0		60.2	70.0	70.0	70.0
54.0		53.5	70.0	70.0	70.0
60.0	114.0	48.2	70.0	68.1	70.0
30.0		50.0	50.0	50.0	50.0
36.0		50.0	50.0	50.0	50.0
42.0		50.0	50.0	50.0	50.0
48.0		50.0	50.0	50.0	50.0
54.0		50.0	50.0	50.0	50.0
60.0		50.0	50.0	50.0	50.0
66.0	120.0	50.0	50.0	50.0	50.0
72.0		50.0	50.0	50.0	50.0
30.0		50.0	50.0	50.0	50.0
36.0		50.0	50.0	50.0	50.0
42.0		50.0	50.0	50.0	50.0
48.0		50.0	50.0	50.0	50.0
54.0		48.2	50.0	50.0	50.0

ANCHORS TYPES: SEE SHEET 10 FOR DESCRIPTION

- A2 = (2) ANCHORS TYPE 'A' AT JAMB OR EACH SIDE OF MULLION
A3 = (3) ANCHORS TYPE 'A' AT JAMB OR EACH SIDE OF MULLION

- B2 = (2) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION
B3 = (3) ANCHORS TYPE 'B' AT JAMB OR EACH SIDE OF MULLION

ALL OTHER ANCHORS TO BE SPACED AS PER ELEVATION

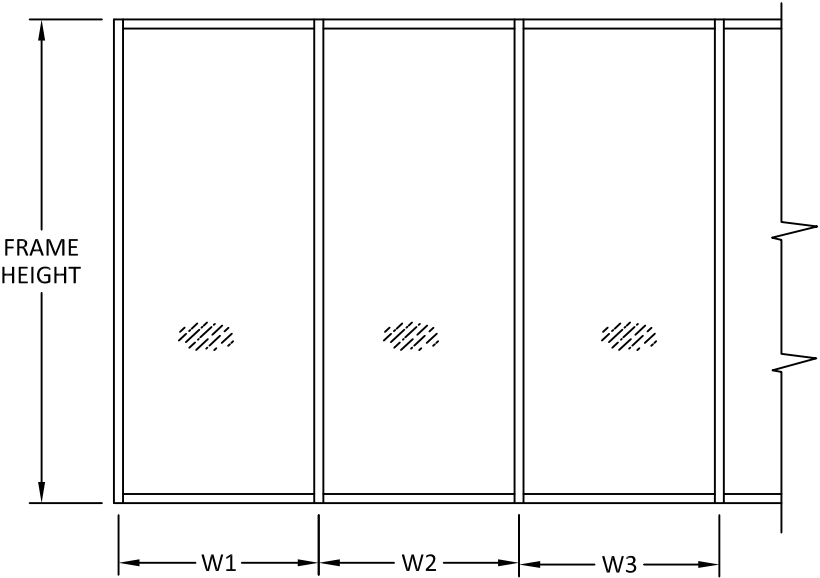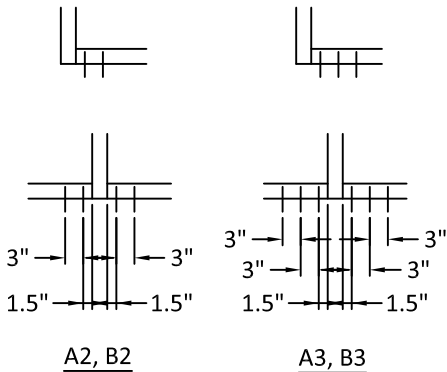

WIDTH (W) = W1 (JAMB)

WIDTH (W) = $\frac{W2 + W3}{2}$ (MULLION)



YKK AP AMERICA

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

TYPE A & B ANCHOR TABLES


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

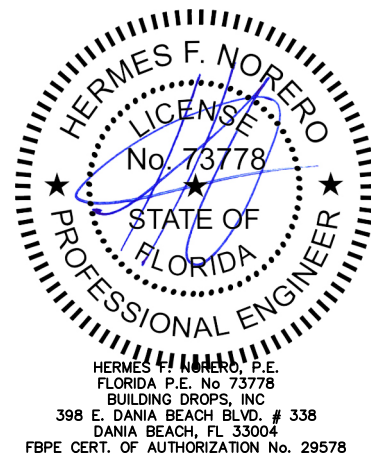

FL #:	FL14218
DATE:	10.20.15
DWG. BY:	SM
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	

6

ANCHOR TYPE 'C & D' TABLES


ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)				
NOMINAL DIMS.		ANCHORS TYPE 'C'		ANCHORS TYPE 'D'
WIDTH (W)	FRAME HEIGHT	C2	C3	D2
30.0	60.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0
42.0		70.0	70.0	70.0
48.0		70.0	70.0	70.0
54.0		70.0	70.0	70.0
60.0		70.0	70.0	70.0
66.0		70.0	70.0	70.0
72.0	66.0	70.0	70.0	70.0
30.0		70.0	70.0	70.0
36.0		70.0	70.0	70.0
42.0		70.0	70.0	70.0
48.0		70.0	70.0	70.0
54.0		70.0	70.0	70.0
60.0		70.0	70.0	70.0
66.0	72.0	70.0	70.0	70.0
72.0		70.0	70.0	70.0
30.0		70.0	70.0	70.0
36.0		70.0	70.0	70.0
42.0		70.0	70.0	70.0
48.0		70.0	70.0	70.0
54.0		70.0	70.0	70.0
60.0	78.0	70.0	70.0	70.0
66.0		70.0	70.0	70.0
72.0		64.2	70.0	70.0
30.0		70.0	70.0	70.0
36.0		70.0	70.0	70.0
42.0		70.0	70.0	70.0
48.0		70.0	70.0	70.0
54.0	84.0	70.0	70.0	70.0
60.0		70.0	70.0	70.0
66.0		64.6	70.0	70.0
72.0		59.2	70.0	70.0
30.0		70.0	70.0	70.0
36.0		70.0	70.0	70.0
42.0		70.0	70.0	70.0

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)				
NOMINAL DIMS.		ANCHORS TYPE 'C'		ANCHORS TYPE 'D'
WIDTH (W)	FRAME HEIGHT	C2	C3	D2
30.0	90.0	70.0	70.0	70.0
36.0		70.0	70.0	70.0
42.0		70.0	70.0	70.0
48.0		70.0	70.0	70.0
54.0		68.4	70.0	70.0
60.0		61.6	70.0	70.0
66.0		56.0	70.0	70.0
72.0	96.0	51.3	70.0	70.0
30.0		70.0	70.0	70.0
36.0		70.0	70.0	70.0
42.0		70.0	70.0	70.0
48.0		70.0	70.0	70.0
54.0		64.2	70.0	70.0
60.0		57.7	70.0	70.0
66.0	102.0	52.5	70.0	70.0
72.0		70.0	70.0	70.0
30.0		70.0	70.0	70.0
36.0		70.0	70.0	70.0
42.0		70.0	70.0	70.0
48.0		70.0	70.0	70.0
54.0		60.4	70.0	70.0
60.0	108.0	54.3	70.0	70.0
30.0		70.0	70.0	70.0
36.0		70.0	70.0	70.0
42.0		70.0	70.0	70.0
48.0		64.2	70.0	70.0
54.0		57.0	70.0	70.0
60.0		51.3	70.0	70.0
30.0	114.0	50.0	50.0	50.0
36.0		50.0	50.0	50.0
42.0		50.0	50.0	50.0
48.0		50.0	50.0	50.0
54.0		50.0	50.0	50.0
30.0	120.0	50.0	50.0	50.0
36.0		50.0	50.0	50.0
42.0		50.0	50.0	50.0
48.0		50.0	50.0	50.0
54.0		50.0	50.0	50.0
30.0		50.0	50.0	50.0
36.0		50.0	50.0	50.0

ANCHORS TYPES: SEE SHEET 10 FOR DESCRIPTION

- C2 = (2) ANCHORS TYPE 'C' AT JAMB OR EACH SIDE OF MULLION
C3 = (3) ANCHORS TYPE 'C' AT JAMB OR EACH SIDE OF MULLION
D2 = (2) ANCHORS TYPE 'D' AT JAMB OR EACH SIDE OF MULLION

ALL OTHER ANCHORS TO BE SPACED AS PER ELEVATION

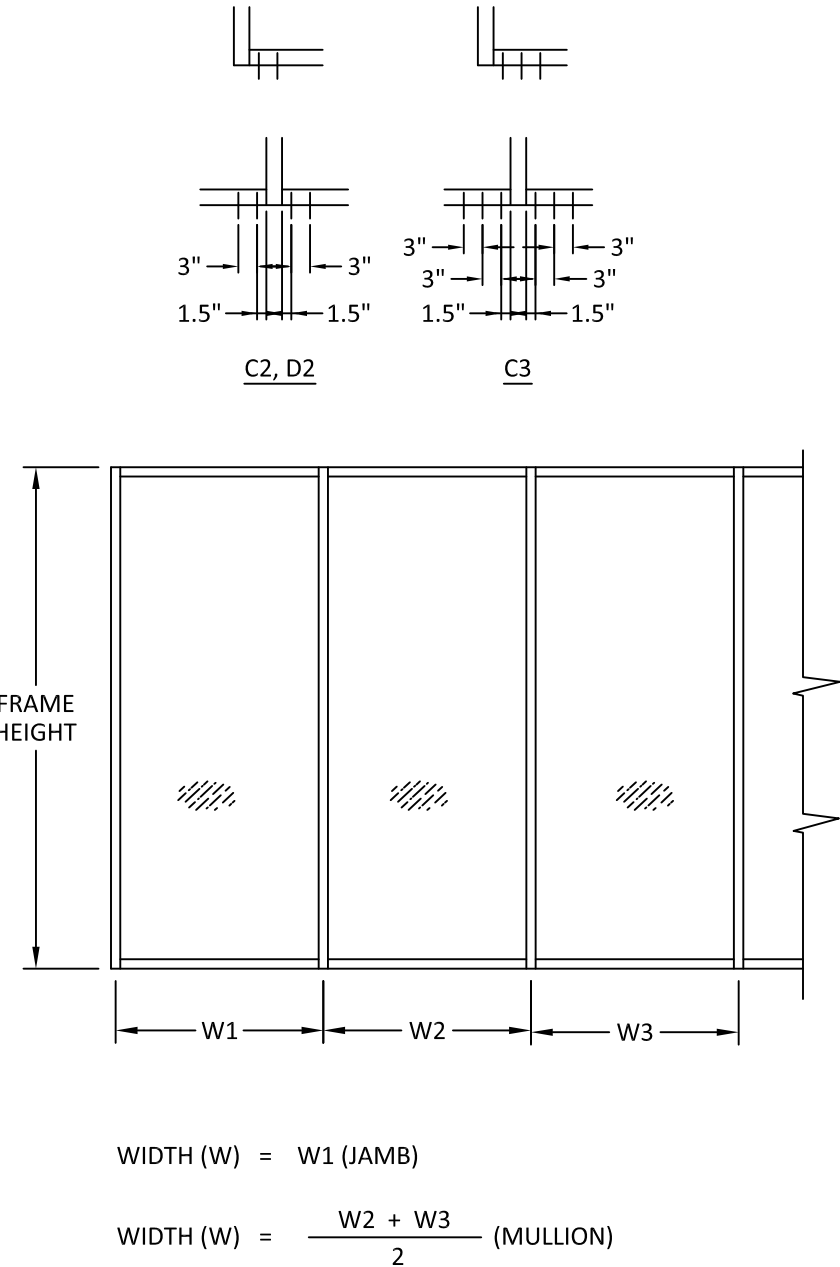

YKK AP AMERICA

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

TYPE C & D ANCHOR TABLES


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17



THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

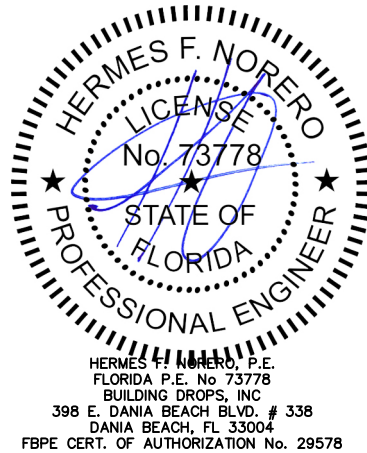

FL #:	FL14218
DATE:	10.20.15
DWG. BY:	SM
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	7

DOOR MULLION LOAD & ANCHOR TABLES

DOOR MULLION LOAD CAPACITY (PSF)					
NOMINAL DIMS.		WITHOUT STEEL REINF.		WITH STEEL REINF.	
WIDTH (W)	FRAME HEIGHT	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
24	102	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		70.0	70.0	70.0	90.0
42		70.0	70.0	70.0	90.0
48		70.0	70.0	70.0	90.0
54		70.0	70.0	70.0	90.0
60		70.0	70.0	70.0	90.0
24	108	70.0	70.0	70.0	90.0
30		70.0	70.0	70.0	90.0
36		70.0	70.0	70.0	90.0
42		70.0	70.0	70.0	90.0
48		70.0	70.0	70.0	90.0
54		70.0	70.0	70.0	90.0
60		70.0	70.0	70.0	90.0

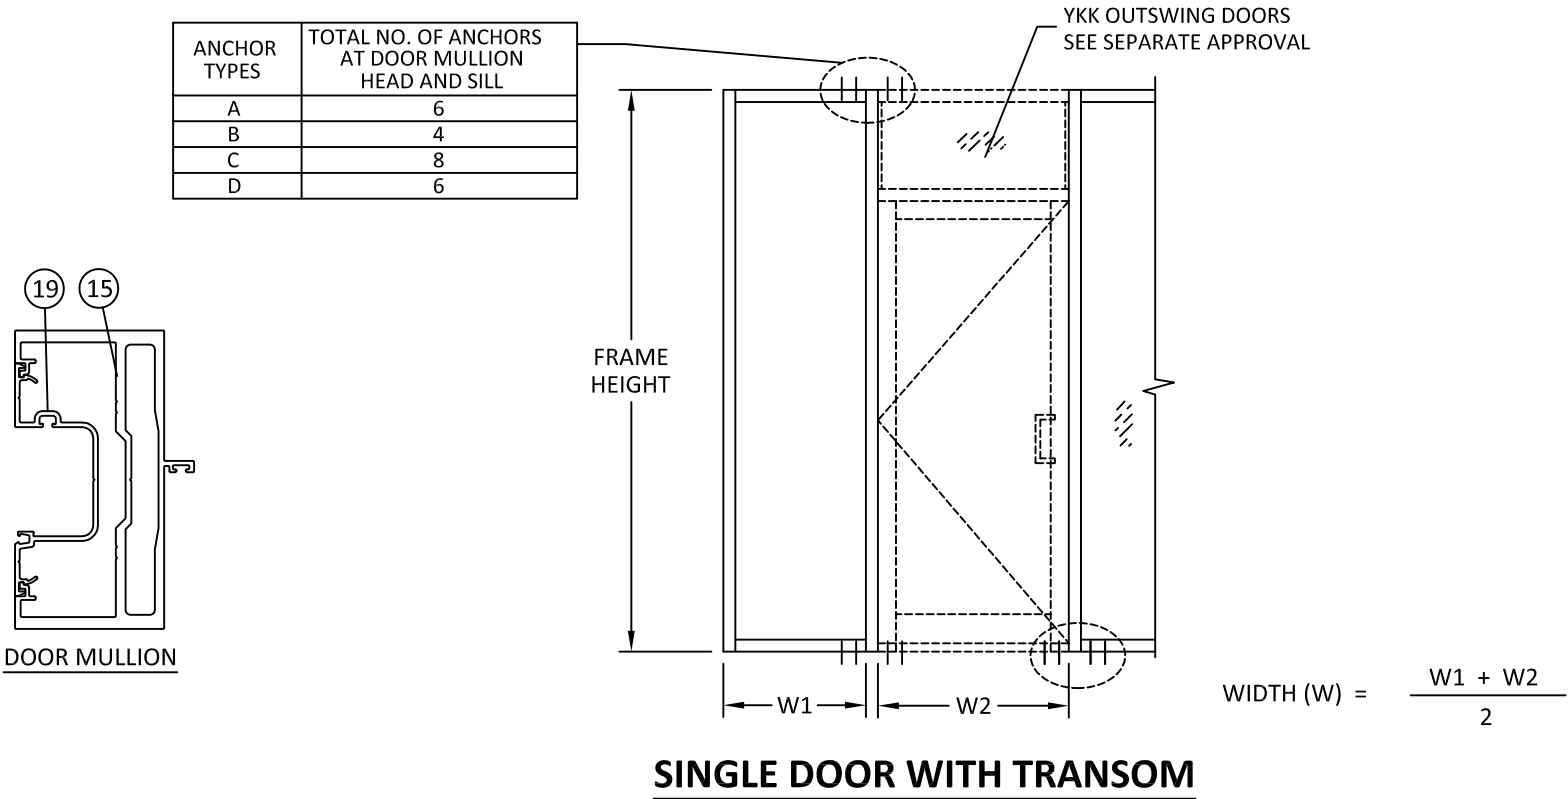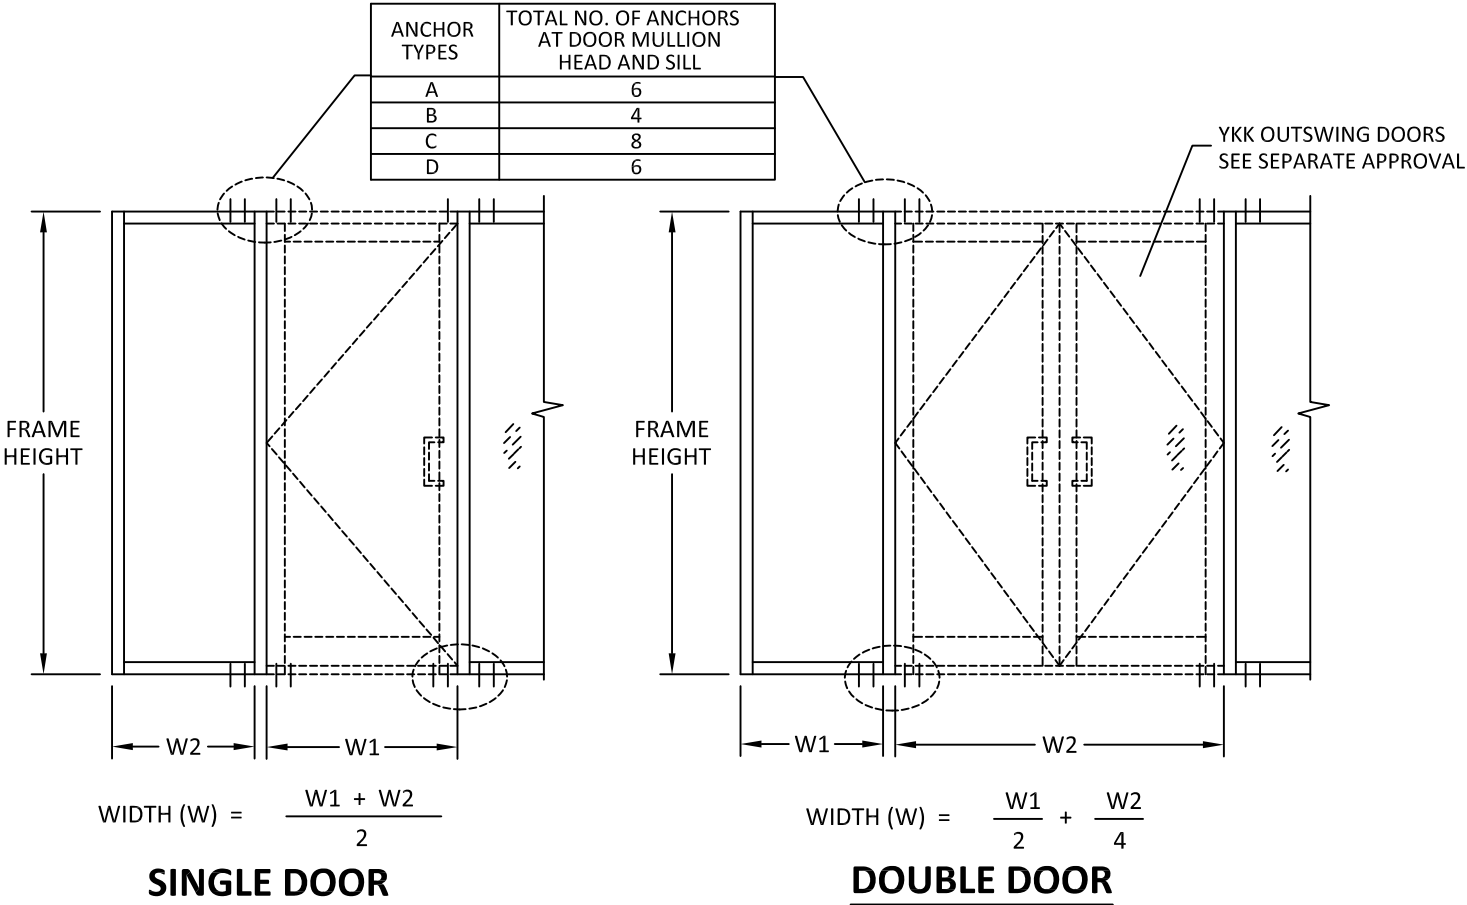

YKK AP AMERICA

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

DOOR MULLION TABLE


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17


THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

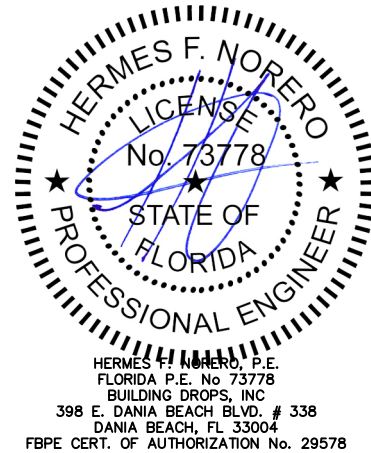

FL #:	FL14218
DATE:	10.20.15
DWG. BY:	SM
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK161
SHEET:	8


DOOR MULLION LOAD & ANCHOR TABLES

DOOR MULLION LOAD CAPACITY (PSF)						
NOMINAL DIMS.			WITHOUT STEEL REINF.		WITH STEEL REINF.	
FRAME HEIGHT (IN.)	DOOR PANEL WIDTH - W1 (IN.)	SIDELITE WIDTH - W2 (IN.)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
96	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	48	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
102	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	48	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
108	36	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	42	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	70.0	70.0	70.0	90.0
	48	30	70.0	70.0	70.0	90.0
		36	70.0	70.0	70.0	90.0
		42	70.0	70.0	70.0	90.0
		48	57.1	57.1	70.0	90.0

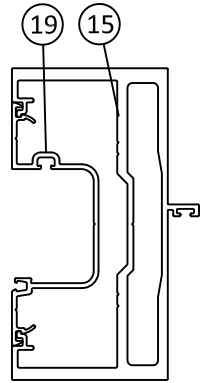

DOOR MULLION

ANCHOR TYPES	TOTAL NO. OF ANCHORS AT DOOR MULLION HEAD AND SILL
A	6
B	4
C	8
D	6

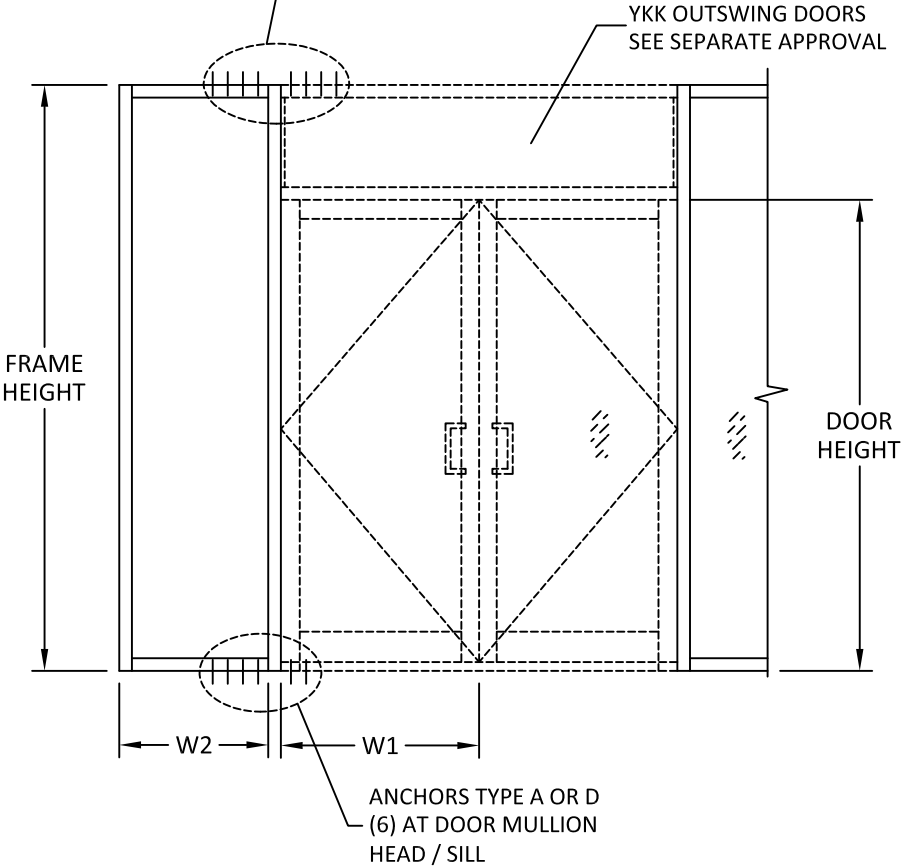

DOUBLE DOOR WITH TRANSOM



YKK AP AMERICA
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

DOOR MULLION TABLES (1)

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL14218

DATE: **10.20.15**

DWG. BY: **SM** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **YKK161**


SHEET:
9

10/13/2017 12:10 AM


s:\projects\ykk ap america, inc.\cc-17-0710 fbc submittal - fbc 2017 (6th edition) code change\week 2 - (aug 4th) documents\dwgs\14218\14218.yhs 50 tu og hvh.dwg

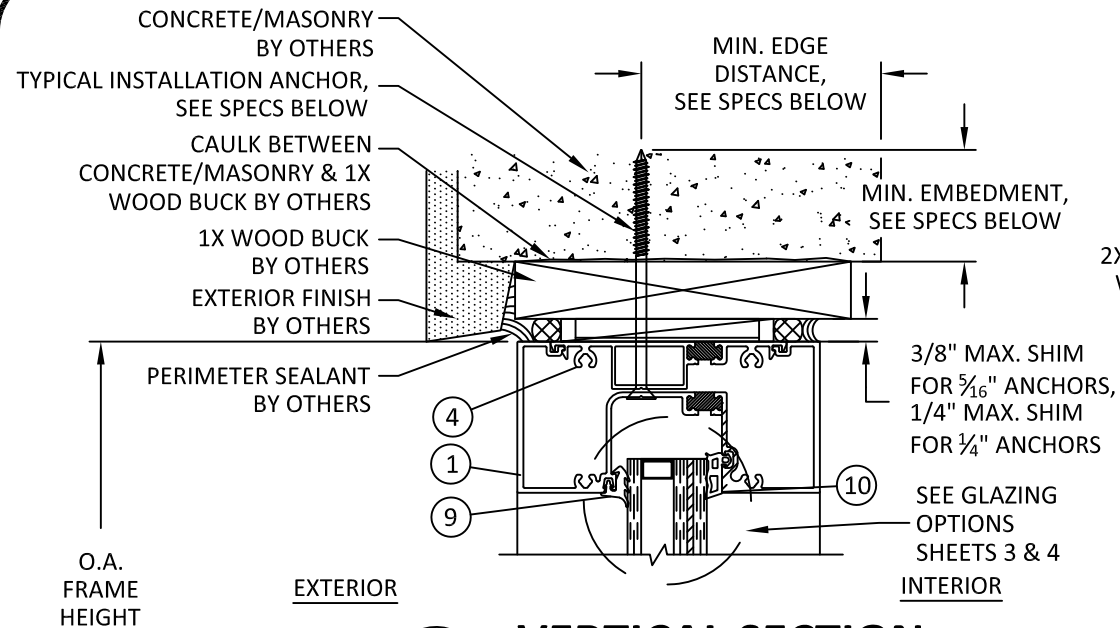

A
10 VERTICAL SECTION
HEAD - CONCRETE/MASONRY W/ 1X BUCK

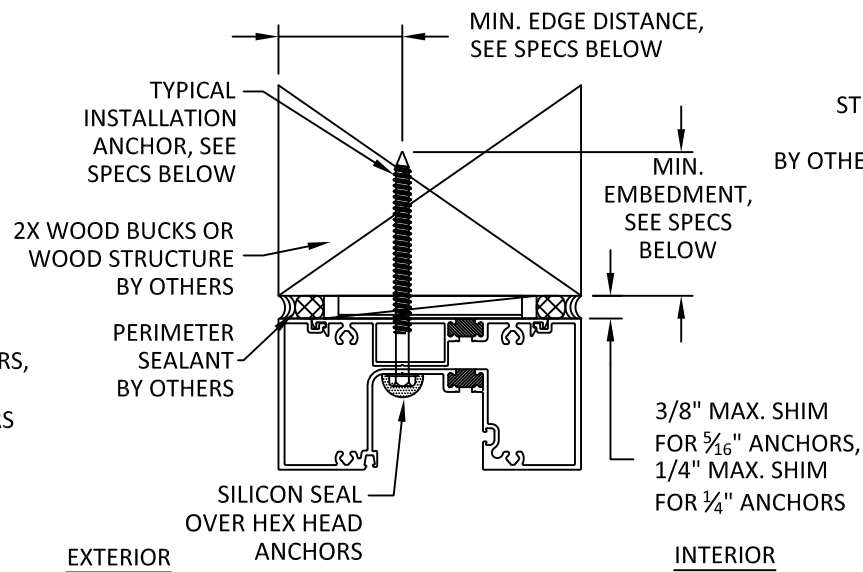


D
10 VERTICAL SECTION
HEAD - WOOD FRAMING
TYPICAL INSTALLATION

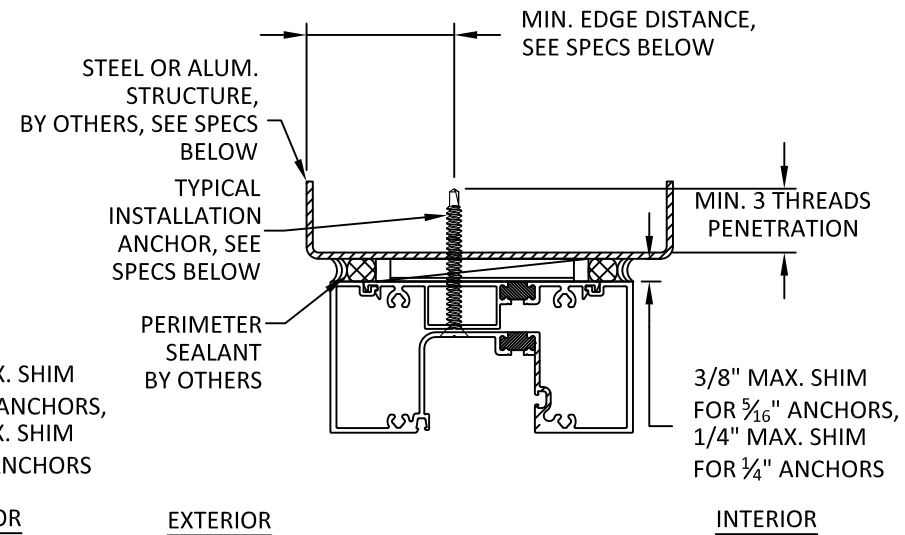

E
10 VERTICAL SECTION
HEAD - METAL SUBSTRATE
TYPICAL INSTALLATION


SEE GLAZING
OPTIONS
SHEETS 3 & 4

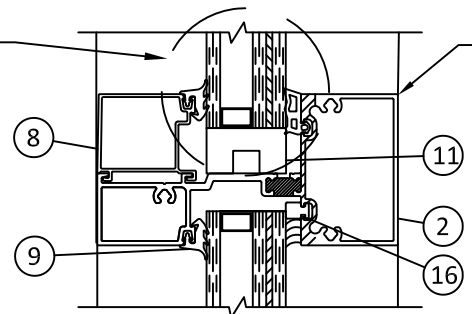

B
10 VERTICAL SECTION
HORIZONTAL MEMBER

LIMIT DESIGN LOADS FOR HORIZONTAL AS FOLLOWS		
MAX HORIZ. SPAN	MAX GLASS HEIGHT ABOVE HORIZ.	MAX DESIGN LOADS
60"	54"	70 PSF
60"	84"	54 PSF

DESIGN LOADS SHOWN ABOVE ARE BASED ON MAX. GLASS
AREA ABOVE HORIZONTAL FOR SMALLER GLASS ABOVE
HORIZONTAL DESIGN LOADS TO BE CALCULATED
SEPARATELY.

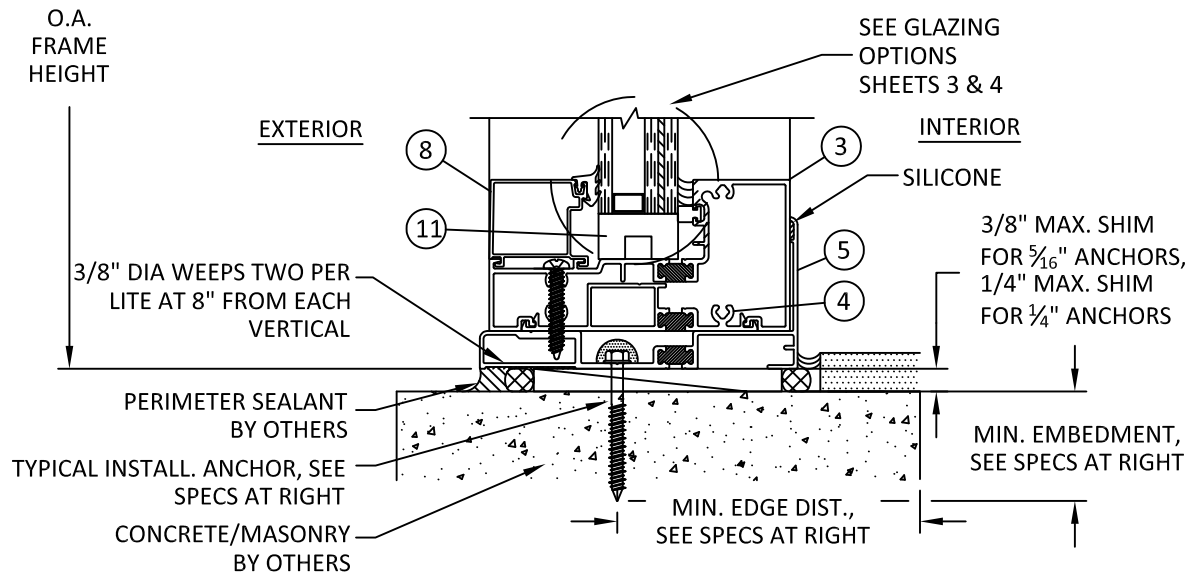

C
10 VERTICAL SECTION
SILL - DIRECT TO CONCRETE/MASONRY

YHS 50 TU ANCHOR TYPES					
ANCHOR TYPE	ANCHOR DESCRIPTION	SUBSTRATE REQUIREMENTS	MIN. EMBEDMENT	MIN. EDGE DISTANCE	NOTES
A	5/16" DIA. TAPCON BY ITW (Fu=125 KSI, Fy=100 KSI)	CONCRETE AT HEAD, SILL OR JAMBS F'C = 3000 PSI MIN.	1-3/4"	3"	FOR USE THROUGH OPTIONAL 1X BUCKS, BY OTHERS
	OR 5/16" DIA. ULTRACON BY ELCO (Fu=177 KSI, Fy=155 KSI)	C-90 HOLLOW/FILLED BLOCK AT JAMBS F'M = 2000 PSI MIN.	1"	3"	
	5/16" DIA. ULTRACON BY ELCO (Fu=177 KSI, Fy=155 KSI)	MIN. S.G. = 0.55 WOOD	1-1/2"	1"	--
B	5/16" DIA. SELF-DRILLING SCREWS (GRADE 5)	STEEL: 12 GA. MIN., Fy=36 KSI MIN. ALUM.: 1/8" MIN., 6063-T5 MIN.	THREE THREADS PENETRATION PAST METAL STRUCTURE	3/4"	STEEL IN CONTACT WITH ALUM. TO BE PLATED OR PAINTED
C	1/4" DIA. TAPCON BY ITW (Fu=125 KSI, Fy=100 KSI)	CONCRETE AT HEAD, SILL OR JAMBS F'C = 3000 PSI MIN.	1-3/4"	2-1/2"	FOR USE THROUGH OPTIONAL 1X BUCKS, BY OTHERS
	OR 1/4" DIA. ULTRACON BY ELCO (Fu=177 KSI, Fy=155 KSI)	C-90 HOLLOW/FILLED BLOCK AT JAMBS F'M = 2000 PSI MIN.	1-3/4"	2-1/2"	
	1/4" DIA. ULTRACON BY ELCO (Fu=177 KSI, Fy=155 KSI)	MIN. S.G. = 0.55 WOOD	1-1/2"	1"	--
D	1/4" DIA. SELF-DRILLING SCREWS (GRADE 5)	STEEL: 12 GA. MIN., Fy=36 KSI MIN. ALUM.: 1/8" MIN., 6063-T5 MIN.	3 THREADS PENETRATION PAST METAL STRUCTURE	3/4"	STEEL IN CONTACT WITH ALUM. TO BE PLATED OR PAINTED
E	1/4" DIA. SELF-DRILLING SCREWS (GRADE 5)	18 GA. MIN. STEEL STUD, Fy = 33 KSI MIN. WITH WOOD BACKING	1-1/2" IN WOOD	1" IN WOOD	--



YKK AP AMERICA
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

VERTICAL SECTIONS
& ANCHOR DESCRIPTIONS


PREPARED BY:
BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

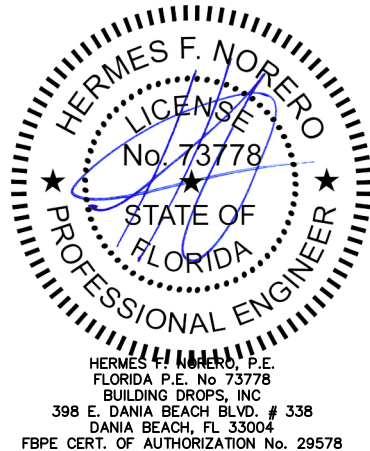

FL #:
FL14218

DATE: **10.20.15**

DWG. BY: **SM** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **YKK161**


SHEET:
10

OF 13


s:\projects\ykk ap america, inc.\cc-17-0710 fbc submittal - fbc 2017 (6th edition) code change\week 2 - (aug 4th) documents\dwgs\14218\14218_10\ykk161_yhs 50 tu og hvh.dwg 10/13/2017 12:10 AM

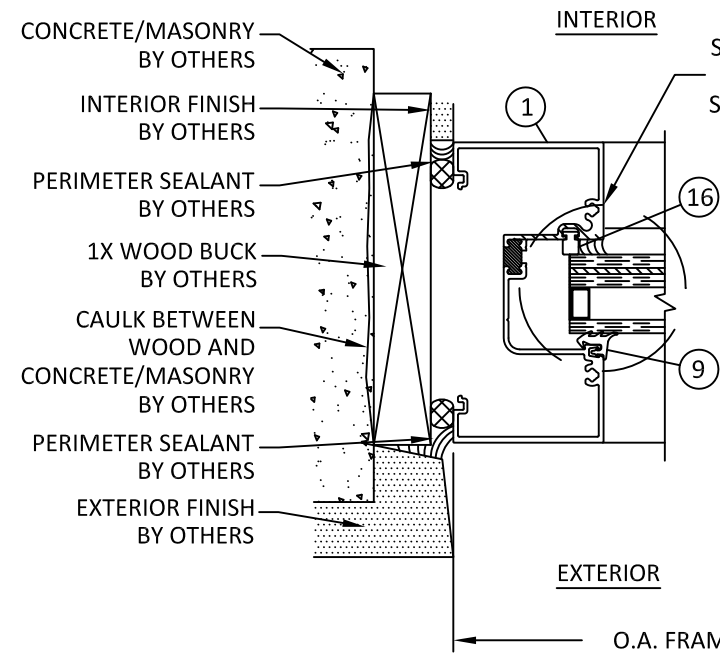


F **HORIZONTAL SECTION**
11 JAMB - CONCRETE/MASONRY W/ 1X BUCK
STANDARD CONFIGURATION

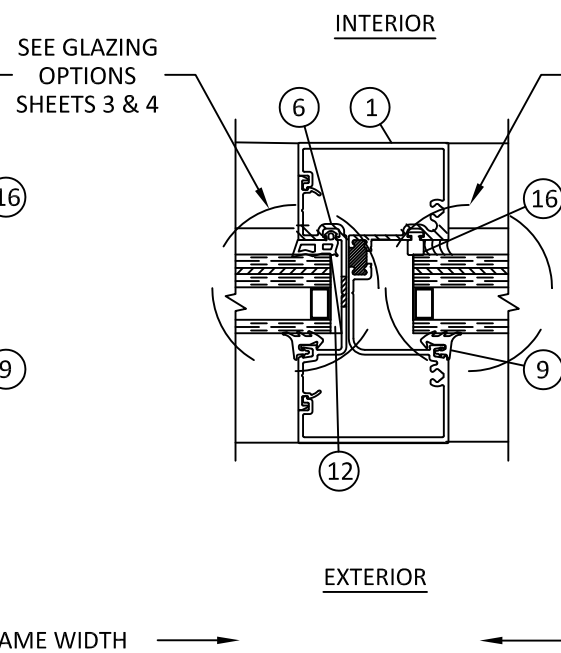


G **HORIZONTAL SECTION**
11 VERTICAL MULLION
STANDARD CONFIGURATION

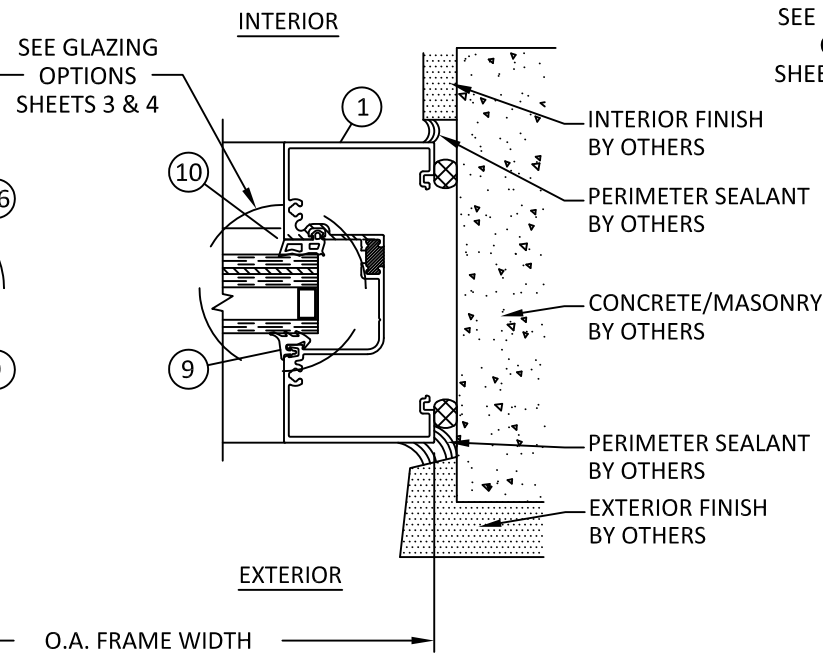


H **HORIZONTAL SECTION**
11 JAMB - DIRECT TO CONCRETE/MASONRY
STANDARD CONFIGURATION

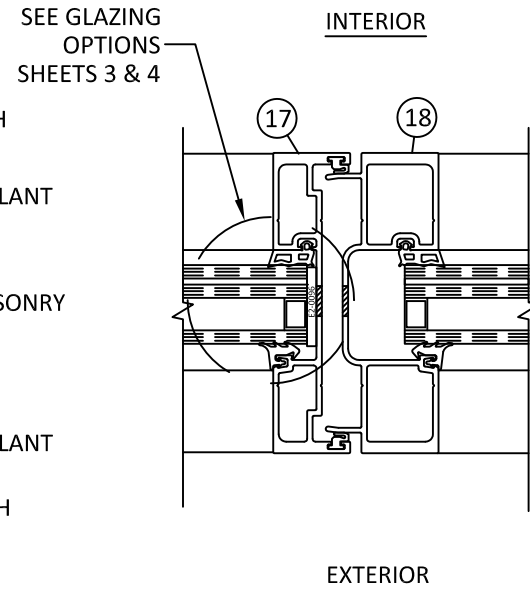


I **HORIZONTAL SECTION**
11 VERTICAL EXPANSION MULLION

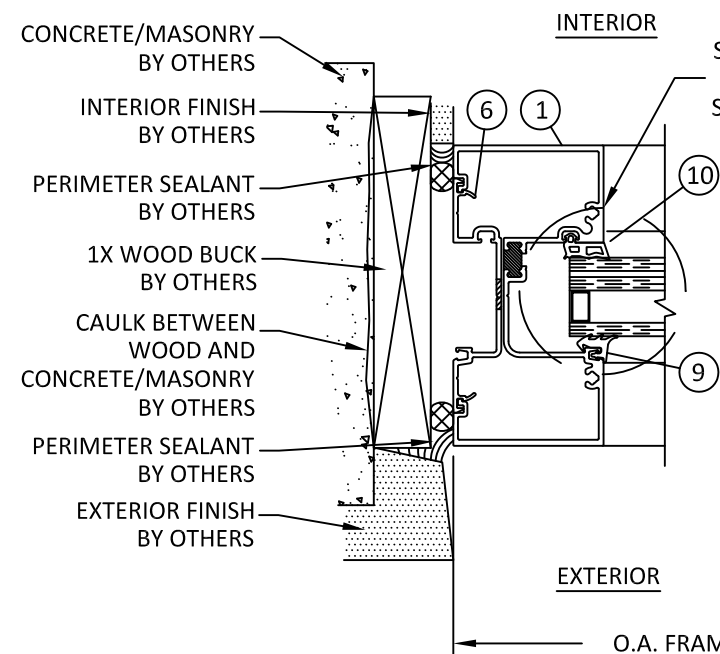


J **HORIZONTAL SECTION**
11 JAMB - CONCRETE/MASONRY W/ 1X BUCK
HEAVY CONFIGURATION

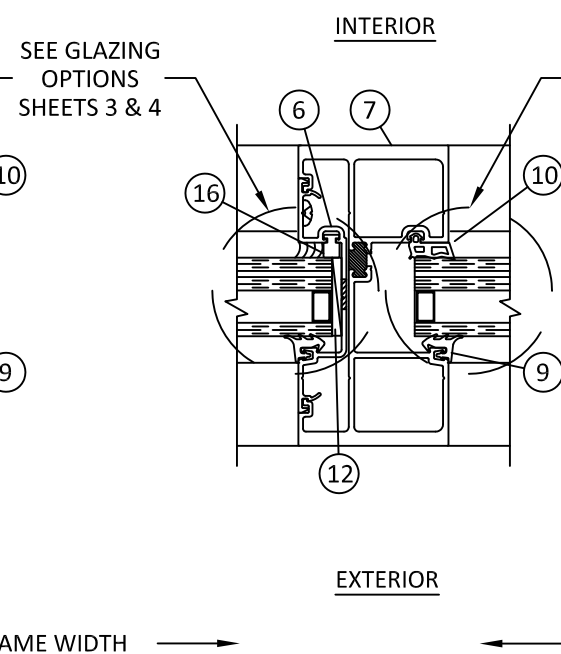

K **HORIZONTAL SECTION**
11 VERTICAL MULLION
HEAVY CONFIGURATION

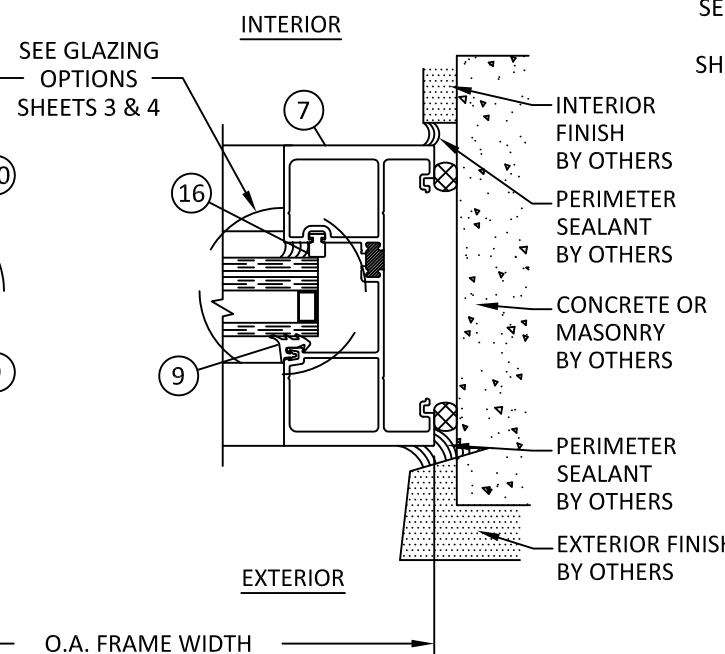

L **HORIZONTAL SECTION**
11 JAMB - DIRECT TO CONCRETE/MASONRY
HEAVY CONFIGURATION

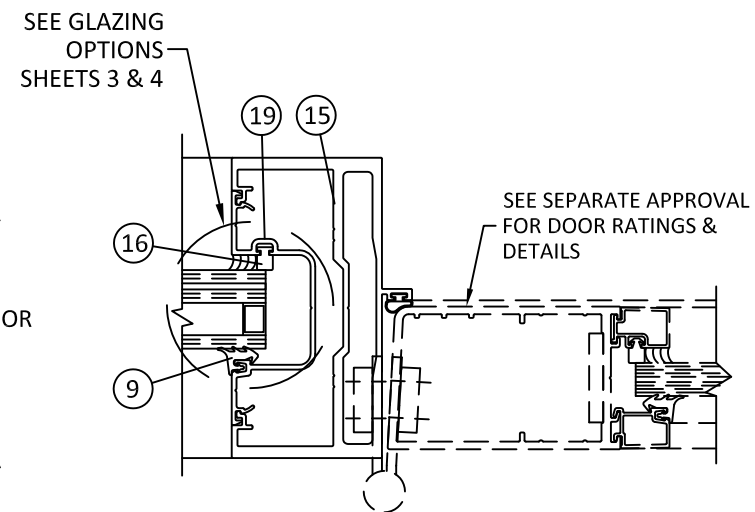

M **HORIZONTAL SECTION**
11 DOOR JAMB MULLION



YKK AP AMERICA
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

HORIZONTAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

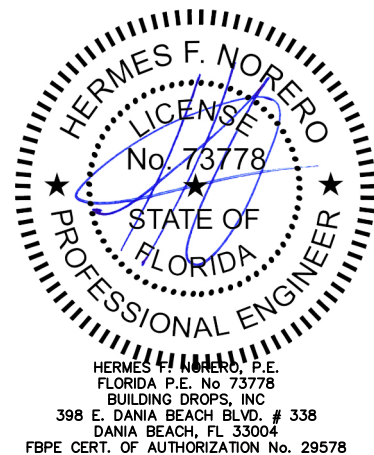

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL14218**

DATE: **10.20.15**

DWG. BY: **SM** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **YKK161**

SHEET:


11

OF 13


ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	BE9-0681	AS NEEDED	FRAME HEAD/SILL/JAMB	6063-T5	-
2	BE9-0683	AS NEEDED	FRAME HORIZONTAL	6063-T5	-
3	BE9-0682	AS NEEDED	FRAME SILL	6063-T5	-
4	E1-1060	AS NEEDED	FLAT FILLER	6063-T5	-
5	BE9-0687	AS NEEDED	SILL FLASHING	6063-T5	-
6	BE9-0655	AS NEEDED	SHALLOW POCKET FILLER	6063-T5	-
7	BE9-0684	AS NEEDED	HEAVY DUTY MULLION	6063-T5	-
8	E9-0658	AS NEEDED	GLAZING STOP	EPDM	-
9	E2-0083	AS NEEDED	EXTERIOR GLAZING GASKET	EPDM	-
10	E2-0088	AS NEEDED	INTERIOR GLAZING GASKET	EPDM SPONGE	-
11	E2-0095	AS NEEDED	SETTING BLOCK	EPDM	-
12	E2-0096	AS NEEDED	SIDE BLOCK	EPDM	-
13	PC-1220	AS NEEDED	ASSEMBLY SCREWS PHSMS	CRS	Ø12 X 1-1/4" PPH SMS
14	PC-1424	AS NEEDED	FOR SILL	CRS	Ø14 X 1-1/2" PPH SMS
15	E9-0504	AS NEEDED	DOOR MULLION	6063-T5	-
16	E2-0084	AS NEEDED	INTERIOR SILICON SPACER	EPDM	-
17	BE9-0688	AS NEEDED	FEMALE MULLION	6063-T5	-
18	BE9-0689	AS NEEDED	MALE MULLION	6063-T5	-
19	E9-0656	AS NEEDED	DEEP POCKET FILLER	6063-T5	-

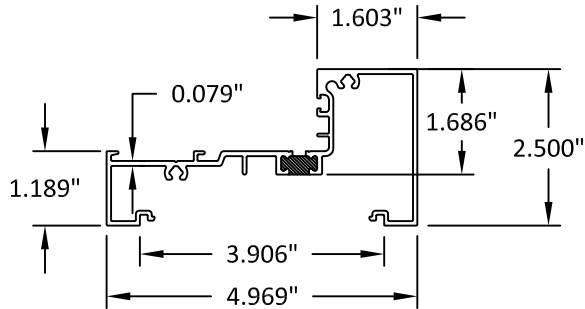


3 FRAME SILL
6063-T5

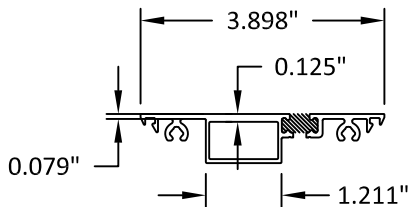


4 FLAT FILLER
6063-T5

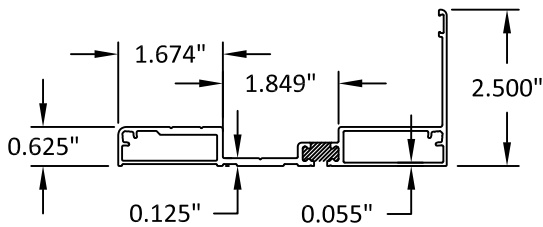


5 SILL FLASHING
6063-T5

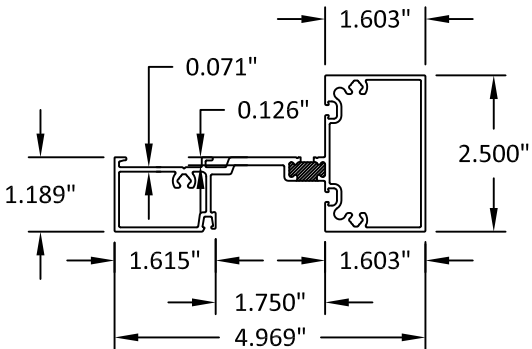


2 FRAME HORIZONTAL
6063-T5

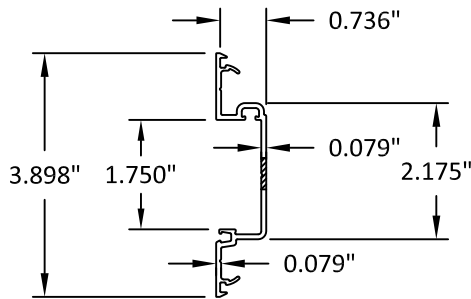


6 SHALLOW POCKET FILLER
6063-T5

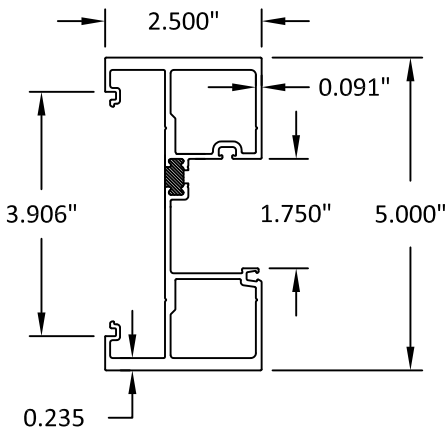


7 HEAVY DUTY MULLION
6063-T5



8 GLAZING STOP
6063-T5

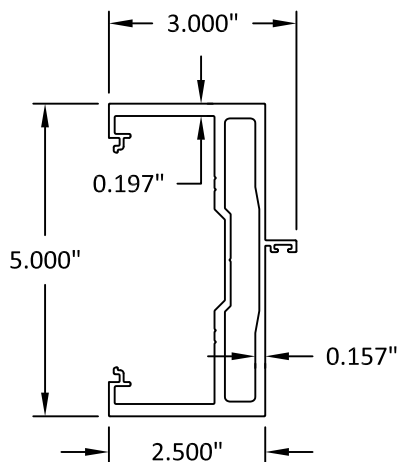

15 DOOR MULLION
6063-T5

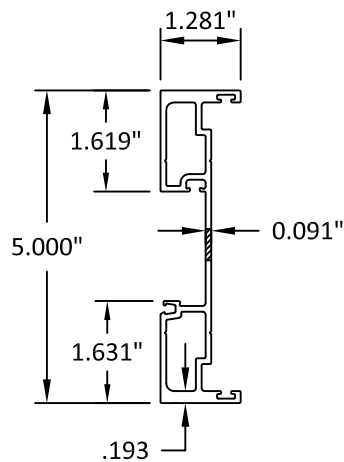

17 FEMALE MULLION
6063-T5



YKK AP AMERICA

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

COMPONENTS & BILL OF MATERIALS

PREPARED BY:


BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

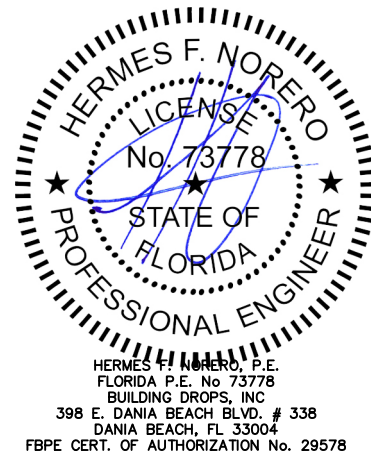

FL #:

FL14218

DATE: 10.20.15

DWG. BY: SM
CHK. BY: HFN

SCALE: NTS


DWG. #: YKK161

SHEET:


12

OF 13

s:\projects\ykk ap america, inc\cc-17-0710 fbc submittal - fbc 2017 (6th edition) code change\week 2 - (aug 4th) documents\dwgs\14218\10\ykk161_yhs 50 tu og hvhz.dwg 10/13/2017 12:10 AM

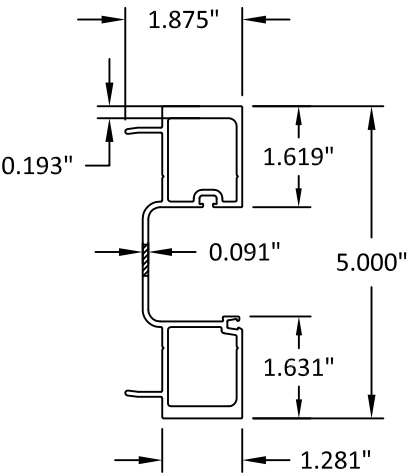

18 MALE MULLION
6063-T5

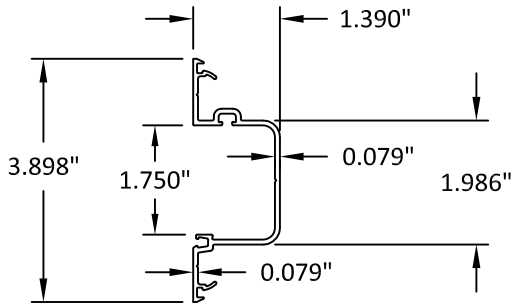

19 DEEP POCKET FILLER
6063-T5



YKK AP AMERICA
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE:
YHS 50 TU
ALUMINUM STOREFRONT SYSTEM

COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
A-GASKET REVISION	LS	10.19.16
B-10' HEIGHT ADDITION	LS	04.12.17

THIS DOCUMENT IS THE PROPERTY OF BUILDING DROPS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF BUILDING DROPS, INC. ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL14218

DATE: **10.20.15**

DWG. BY: **SM** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **YKK161**

SHEET:
13
OF 13